


*SLOPE SHALL NOT EXCEED 100% (45°)

PROFILE VIEW

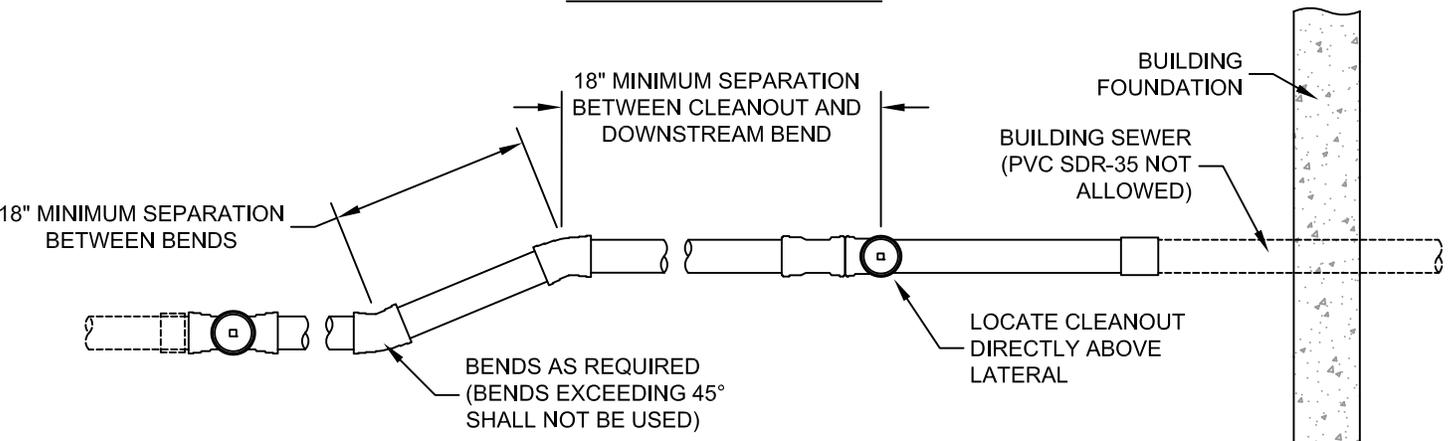

PLAN VIEW

- NOTES:**
1. CLEANOUTS ARE REQUIRED ON PRIVATE LATERALS AT THE FOLLOWING LOCATIONS:
 - WITHIN 5 FEET OF THE BUILDING FOUNDATION.
 - AT NO MORE THAN 100 FEET APART, MEASURED FROM THE UPSTREAM ENTRANCE OF THE CLEANOUT.
 2. BENDS EXCEEDING 45° SHALL NOT BE USED.
 3. FUSION WELD OR SOLVENT WELD FITTINGS AND JOINTS REQUIRED ON VERTICAL BENDS AND ON SLOPES GREATER THAN 3:1 (33%)
 4. MAINTAIN 10' MINIMUM SEPARATION BETWEEN LATERAL AND ANY ADJACENT WATER MAIN LINE OR LATERAL.
 5. SEPARATION FROM AN ADJACENT RETAINING WALL FACE SHALL MEET THE MINIMUM VERTICAL DEPTH REQUIREMENTS.
 6. MINIMUM BURY DEPTH MUST BE ACHIEVED WITHIN 30" OF FOUNDATION WALL.