


INSTALL FRAME AND COVER IN PAVED AREAS.  
(D&L SUPPLY H-8030 OR APPROVED EQUAL)

INSTALL 10" DIAMETER OR LARGER  
SPRINKLER IRRIGATION  
BOX IN UNPAVED AREAS

CONCRETE OR  
ASPHALT PAVEMENT

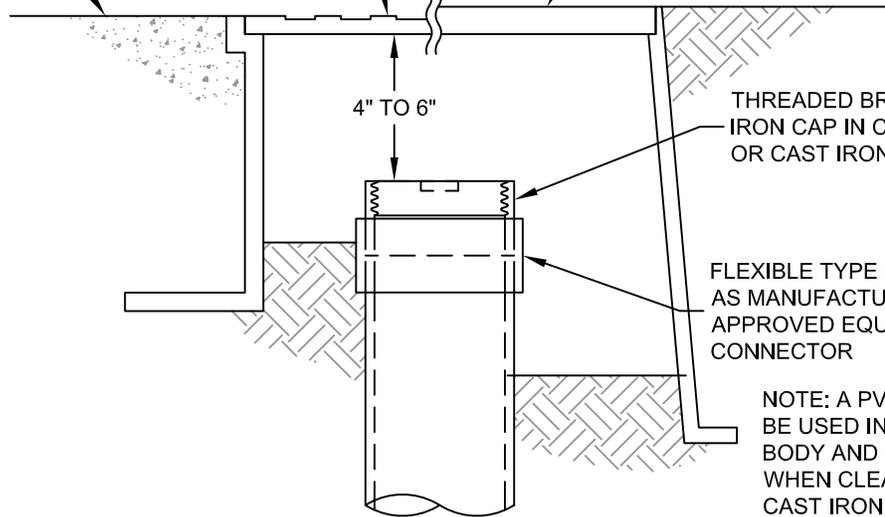


THREADED BRASS OR CAST  
IRON CAP IN CAST IRON BODY  
OR CAST IRON BLIND CAP.

FLEXIBLE TYPE NEOPRENE COUPLING  
AS MANUFACTURED BY FERNCO OR  
APPROVED EQUAL OR NO-HUB TYPE  
CONNECTOR

NOTE: A PVC THREAD ADAPTER MAY  
BE USED IN PLACE OF THE CAST IRON  
BODY AND NEOPRENE COUPLING  
WHEN CLEANOUT IS LOCATED IN A  
CAST IRON FRAME AND COVER.

## CLEANOUT CAP ASSEMBLY WITH PROTECTIVE BOX

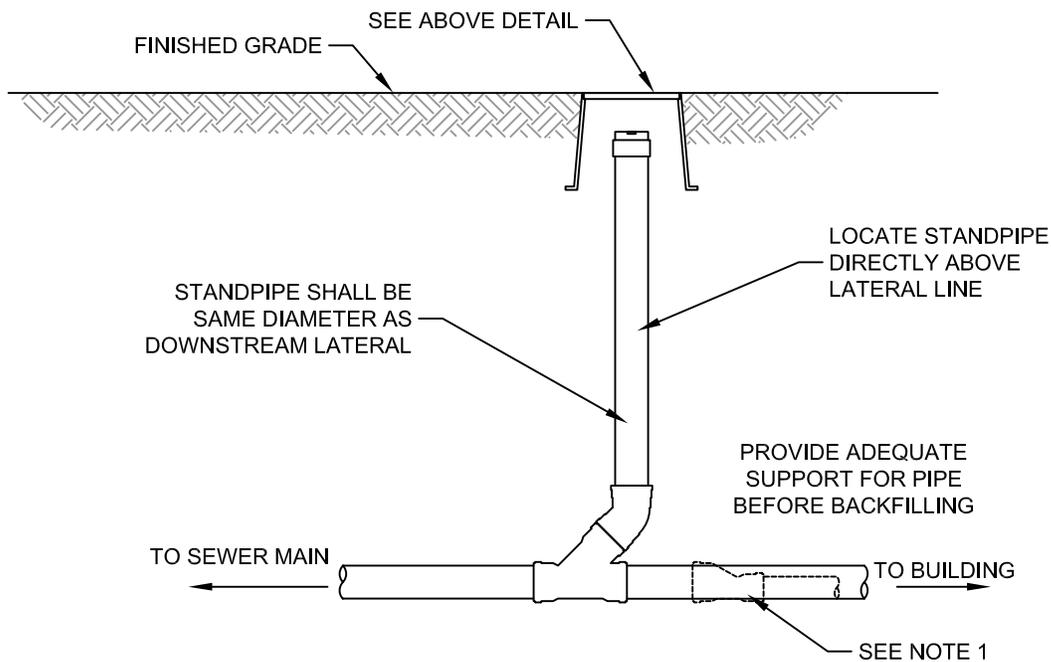

## SANITARY SEWER CLEANOUT

**NOTES:**

1. FOR TRANSITION FROM 4" (UPSTREAM) TO 6" (DOWNSTREAM) LATERALS, TRANSITION SHALL OCCUR AT A CLEANOUT AND SHALL BE ACCOMPLISHED WITH AN ECCENTRIC REDUCER ON THE UPSTREAM SIDE OF THE WYE.
2. FOR LATERALS USING HDPE PIPE:
  - 45° BEND SHALL BE 3 SEGMENT HDPE BEND
  - WYE SHALL BE PREFABRICATED (NOT MOLDED) WYE
  - ALL JOINTS SHALL BE FUSION WELDED



**Snyder Basin Water  
Reclamation District**

## SANITARY SEWER CLEANOUT AND PROTECTIVE BOX

STANDARD DETAIL

**LAT-07**

Revision Date: 2/23/26