


**PROFILE**

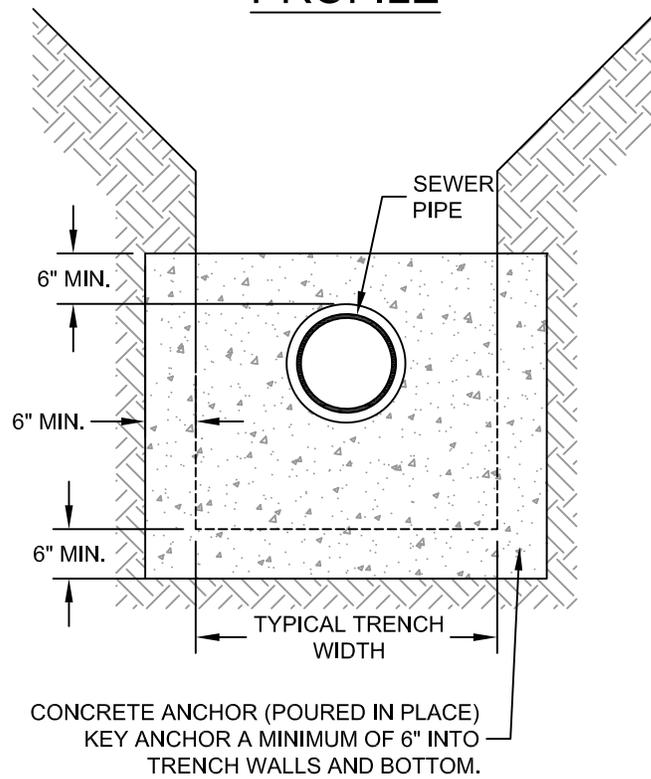

**SECTION**

**NOTES:**

1. INSTALL PIPE ANCHORS ON ALL PIPE WITH SLOPES GREATER THAN 33%.
2. PIPE ANCHORS SHALL BE PLACED AT ALTERNATING BUTT-FUSED JOINTS (80' OR 100' SPACING).



**Snyder Basin Water  
Reclamation District**

**PIPE ANCHOR  
(HDPE MAIN LINE)**

**STANDARD DETAIL**

**PI-05**

Revision Date: 2/23/26