



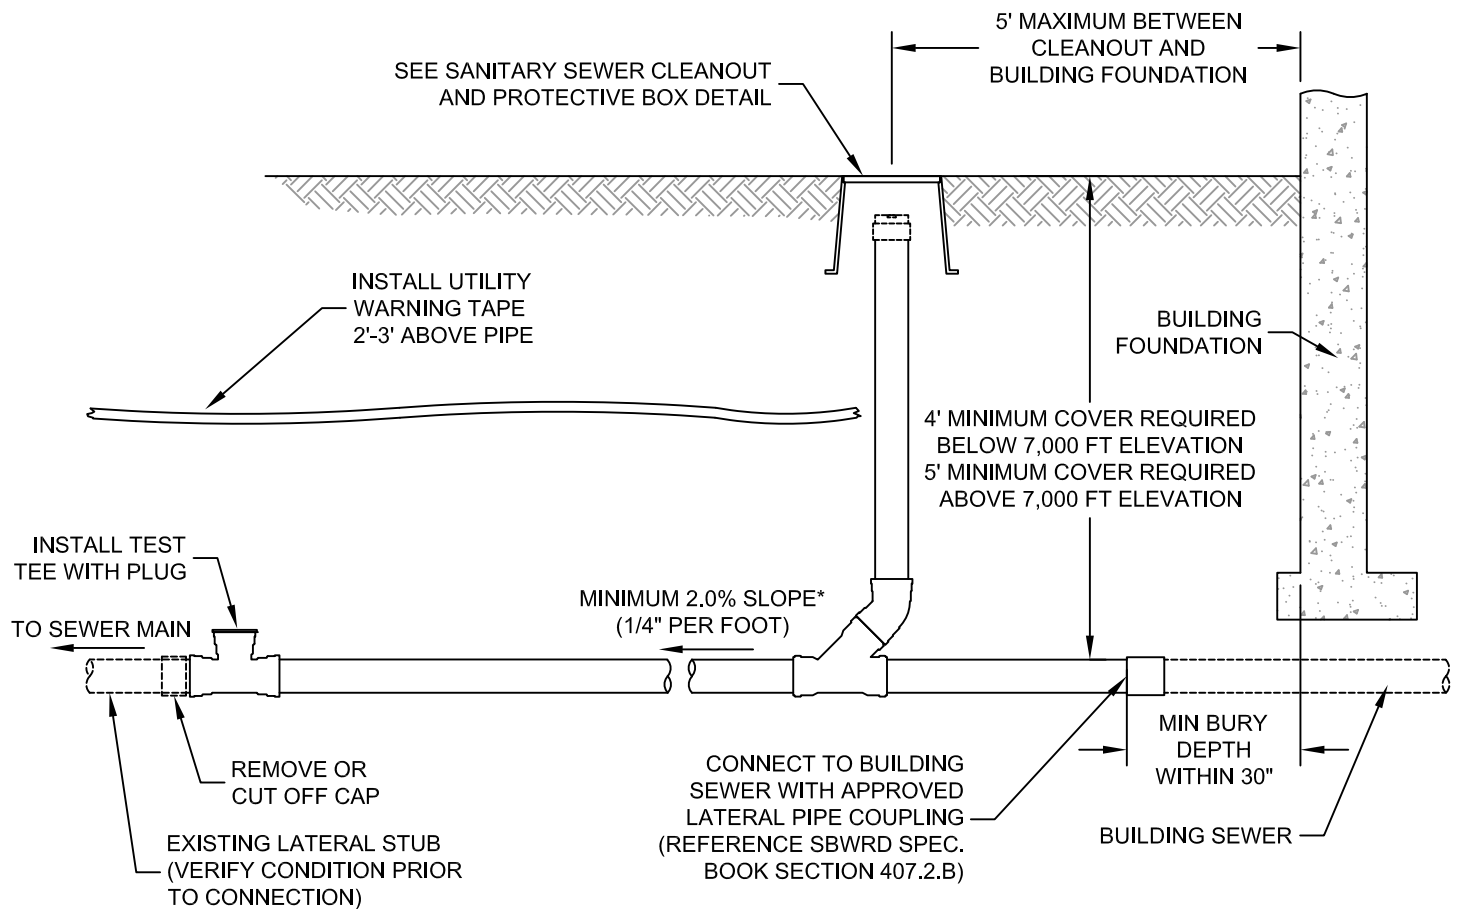

PROFILE VIEW

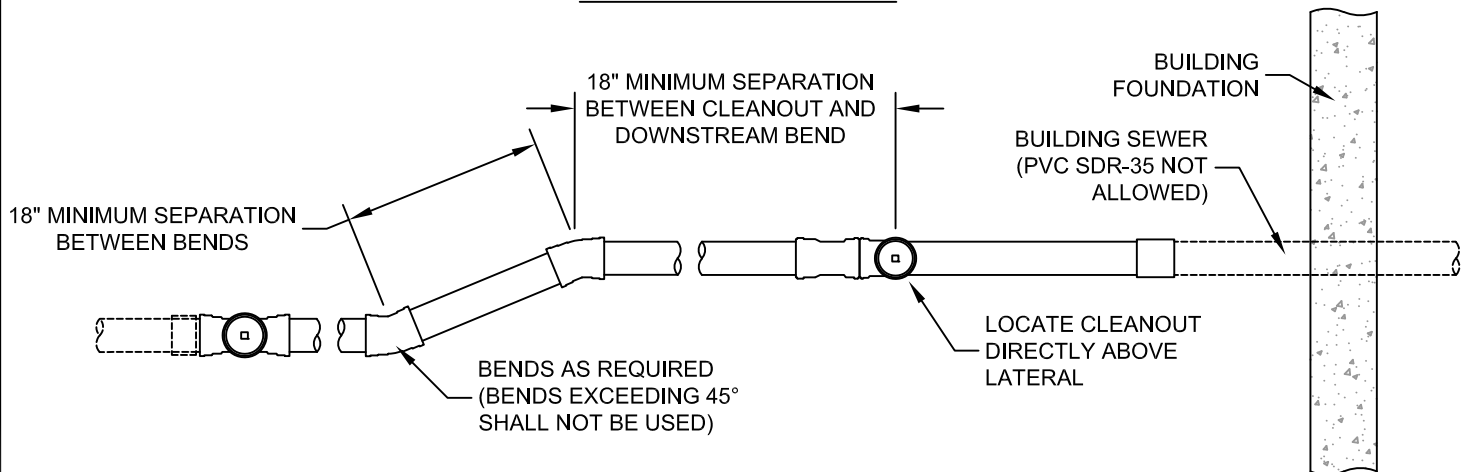

PLAN VIEW

NOTES:

- CLEANOUTS ARE REQUIRED ON PRIVATE LATERALS AT THE FOLLOWING LOCATIONS:
 - WITHIN 5 FEET OF THE BUILDING FOUNDATION.
 - AT NO MORE THAN 100 FEET APART, MEASURED FROM THE UPSTREAM ENTRANCE OF THE CLEANOUT.
- BENDS EXCEEDING 45° SHALL NOT BE USED.
- FUSION WELD OR SOLVENT WELD FITTINGS AND JOINTS REQUIRED ON VERTICAL BENDS AND ON SLOPES GREATER THAN 3:1 (33%)
- MAINTAIN 10' MINIMUM SEPARATION BETWEEN LATERAL AND ANY ADJACENT WATER MAIN LINE OR LATERAL.
- SEPARATION FROM AN ADJACENT RETAINING WALL FACE SHALL MEET THE MINIMUM VERTICAL DEPTH REQUIREMENTS.
- MINIMUM BURY DEPTH MUST BE ACHIEVED WITHIN 30" OF FOUNDATION WALL.



**Snyder Basin Water
Reclamation District**

GRAVITY LATERAL STUB TO GRAVITY BUILDING CONNECTION

STANDARD DETAIL

LAT-05

Revision Date: 2/23/26