




NOTES:

1. ALL HDPE JOINTS SHALL BE BUTT FUSED. ALL PVC PIPE AND FITTINGS SHALL BE SCH. 80 PVC WITH THREADED JOINTS

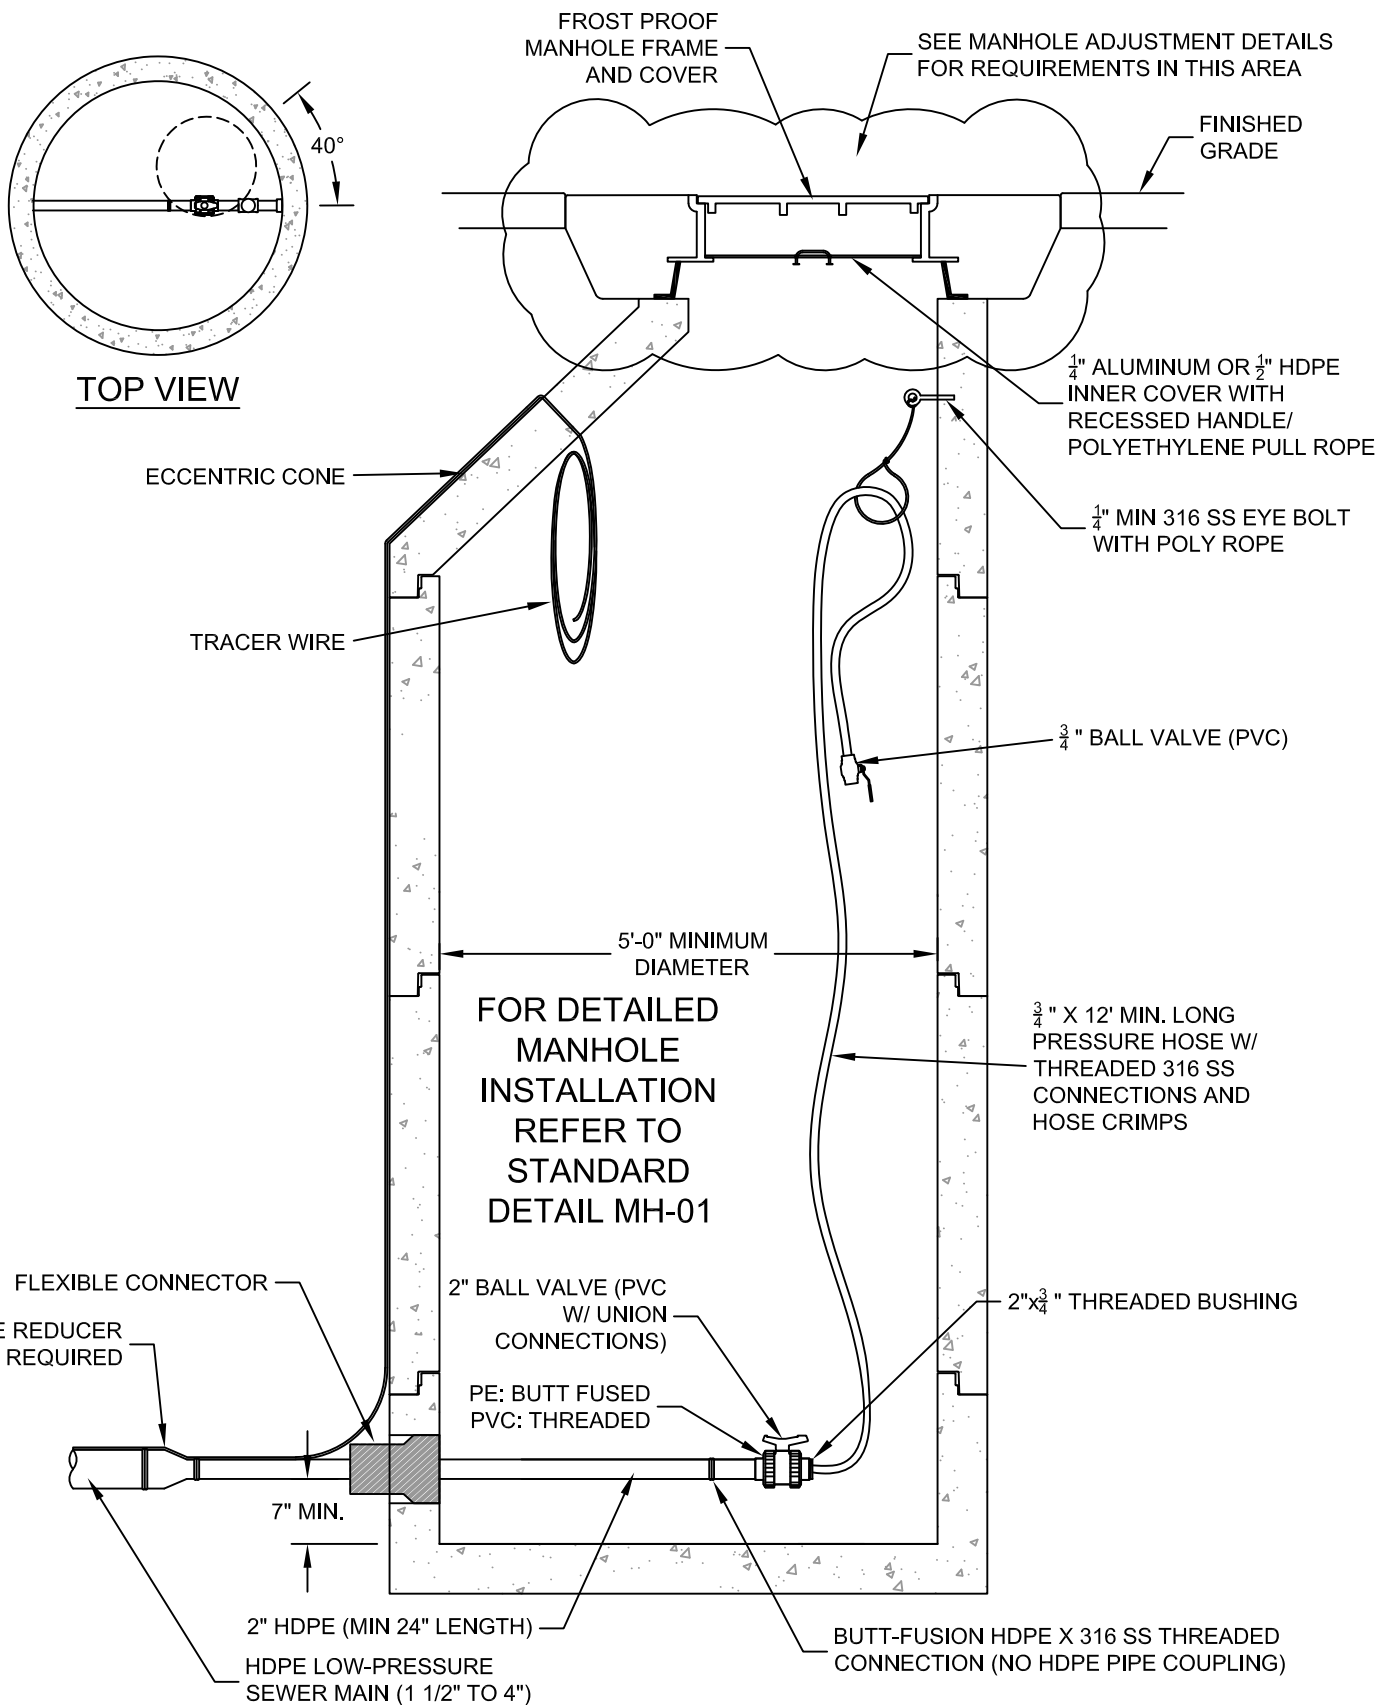

**Snyder Basin Water
Reclamation District**

DEAD END LOW-PRESSURE FLUSHING CONNECTION

STANDARD DETAIL

LP-02

Revision Date: 2/23/26