




NOTES:

1. ALL PIPE AND FITTINGS SHALL BE SCHEDULE 80 PVC.
2. ALL METALLIC HARDWARE AND ACCESSORY EQUIPMENT SHALL BE 316 STAINLESS STEEL.
3. CABLE SHALL BE OF SUFFICIENT LENGTH TO ALLOW THE ODOR CONTROL UNIT TO BE PLACED ON THE SURROUNDING SURFACE WITHOUT THE NEED TO DISCONNECT THE CLAMP.
4. COMBINATION AIR VALVE MANHOLES SHALL BE POLYMER CONCRETE.

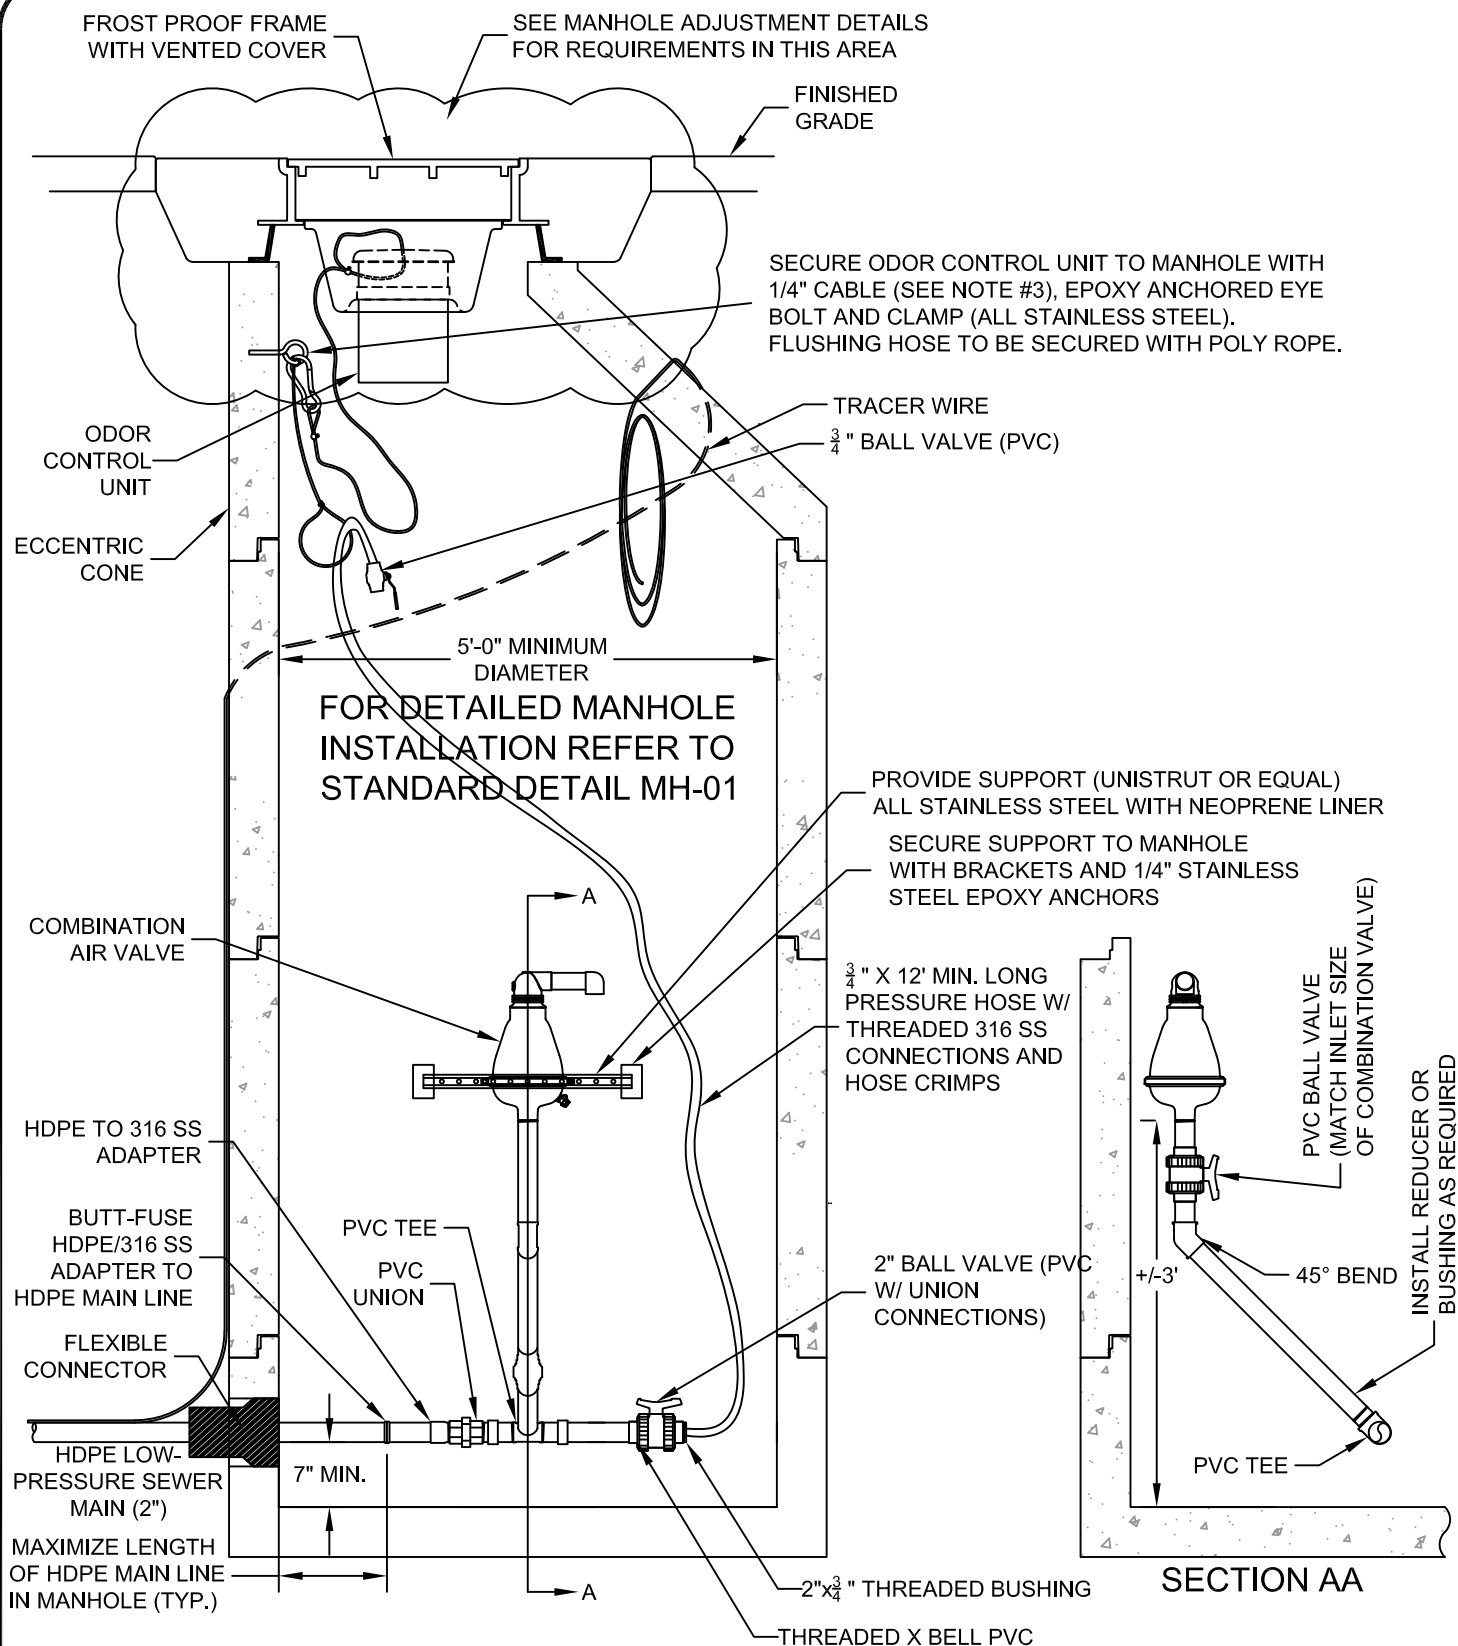

**Snyder Basin Water
Reclamation District**

DEAD END LOW-PRESSURE COMBINATION AIR VALVE

STANDARD DETAIL

LP-03A

Revision Date: 2/23/26