




NOTES:

1. 7' MINIMUM COVER FOR LOW-PRESSURE LATERALS LOCATED UNDER AREAS THAT MAY BE CLEARED OF SNOW AND HAVE VEHICULAR TRAFFIC.
2. BENDS EXCEEDING 45° SHALL NOT BE USED.
3. FUSION WELD OR SOLVENT WELD FITTINGS AND JOINTS REQUIRED ON VERTICAL BENDS AND ON SLOPES GREATER THAN 3:1 (33%).
4. SEPARATION FROM AN ADJACENT RETAINING WALL FACE SHALL MEET THE MINIMUM VERTICAL DEPTH REQUIREMENTS.
5. MINIMUM BURY DEPTH MUST BE ACHIEVED WITHIN 30" OF FOUNDATION WALL.

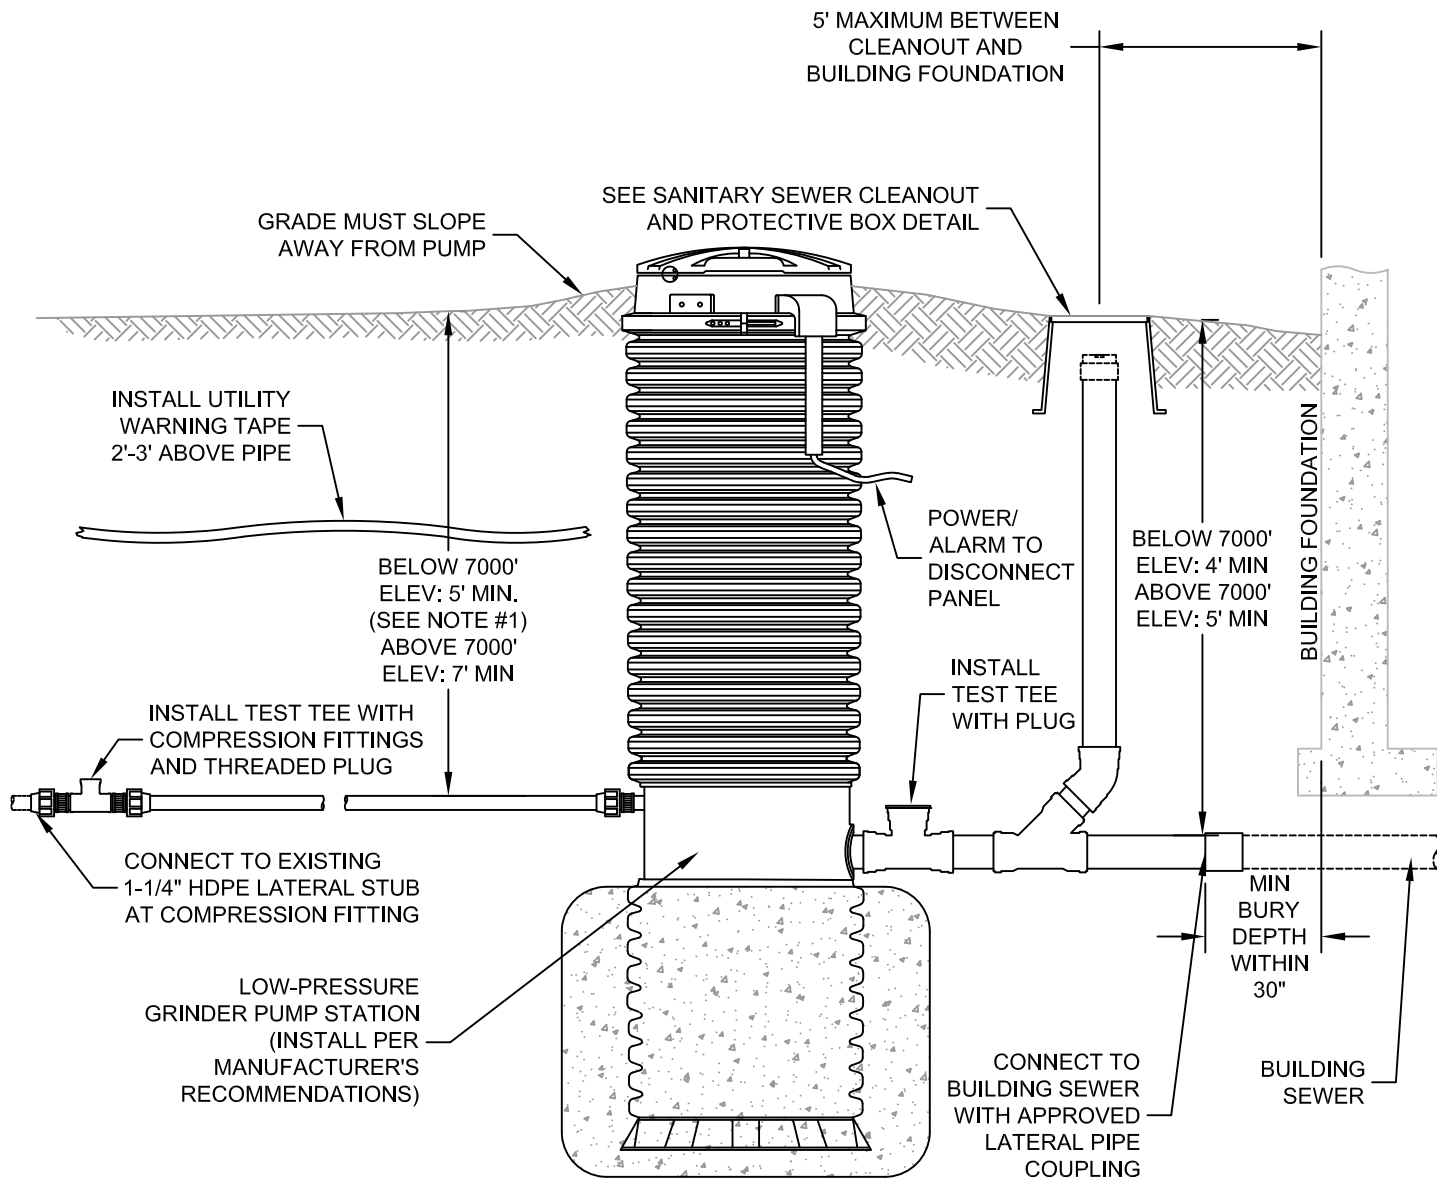

**Snyder Basin Water
Reclamation District**

LOW-PRESSURE LATERAL STUB TO BUILDING CONNECTION

STANDARD DETAIL

LP-05

Revision Date: 2/23/26