



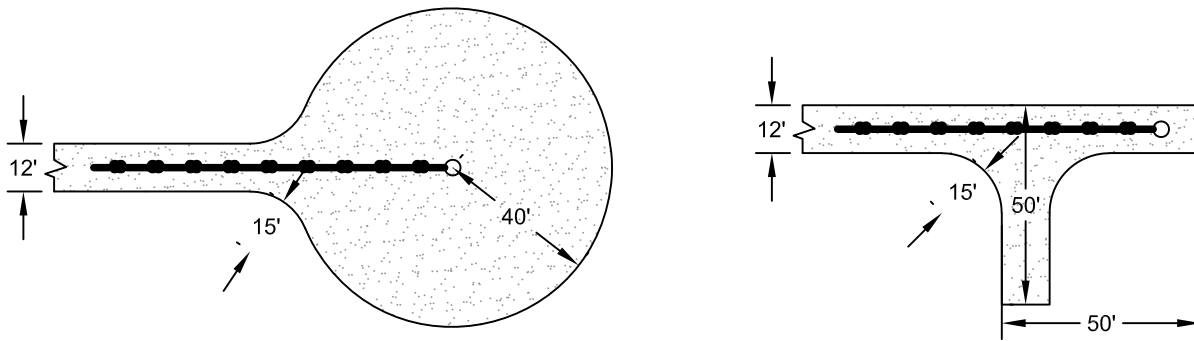

ACCESS TURN-AROUND DETAILS

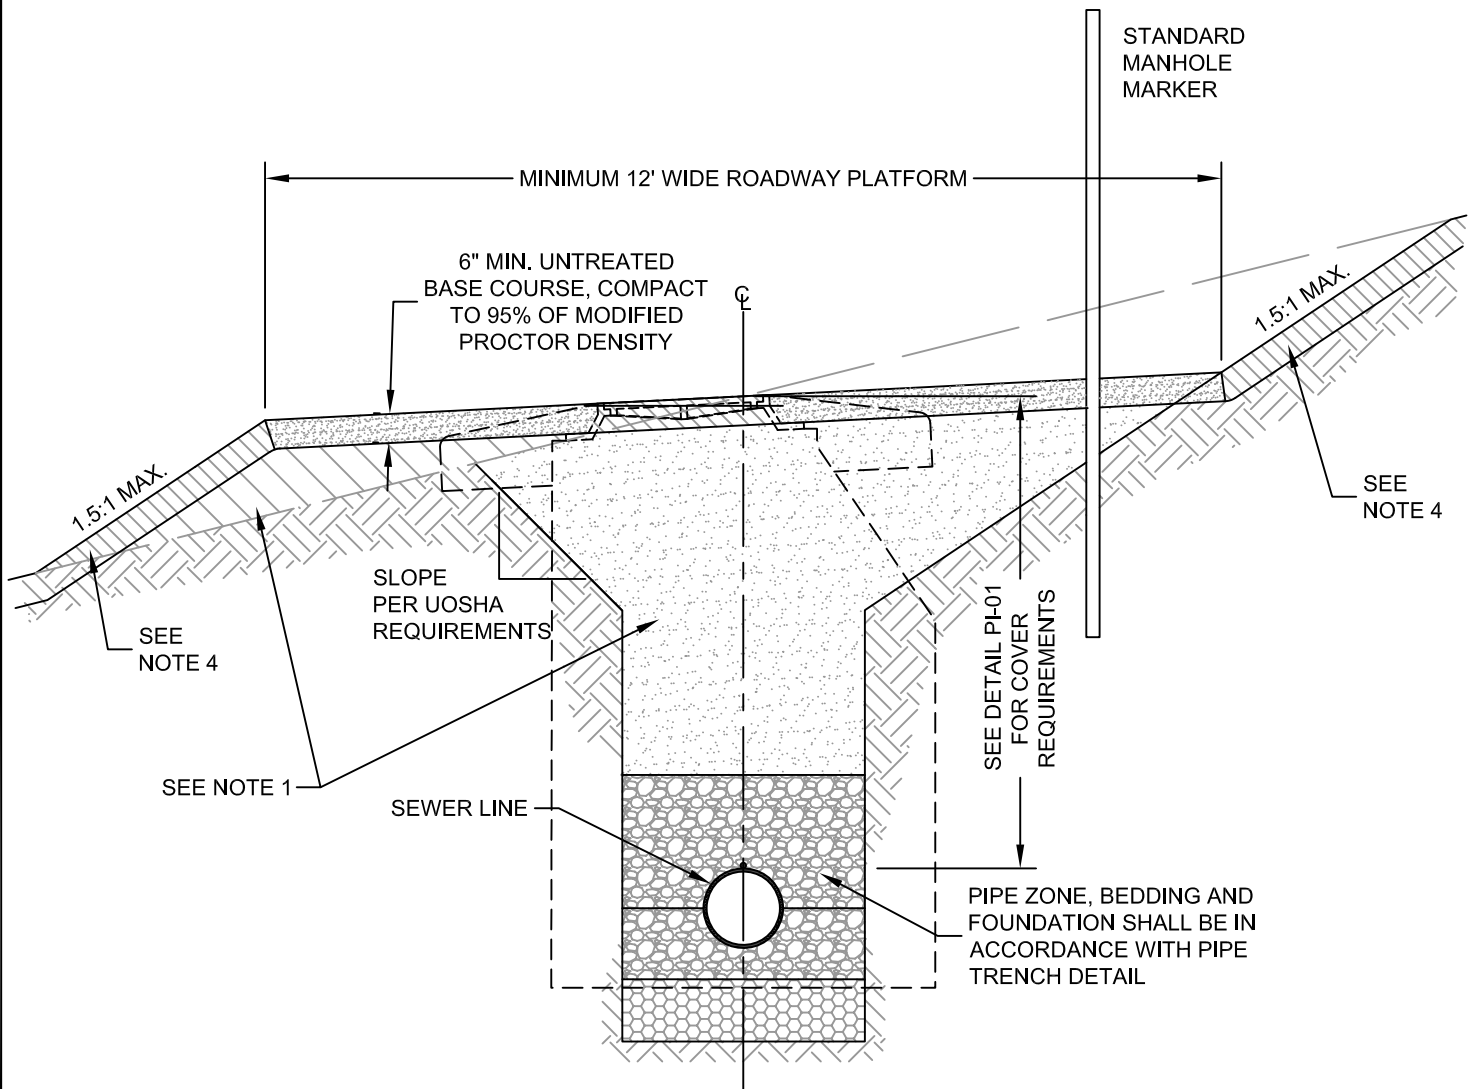

NOTES:

1. BACKFILL MATERIAL ABOVE PIPE ZONE AND IN FILL AREAS SHALL BE ACCEPTABLE MATERIAL FREE OF HARD CLODS OR FROZEN MATERIAL AND EXCESSIVE AMOUNTS OF LARGE ROCKS. COMPACT TO 90% OF MODIFIED PROCTOR DENSITY. IF EXISTING MATERIAL CANNOT MEET COMPACTION REQUIREMENTS IMPORT MATERIAL WILL BE REQUIRED.
2. A ROADWAY PLATFORM WITH A MINIMUM 12' WIDTH AND MAXIMUM 5% CROSS SLOPE SHALL BE PROVIDED OVER ALL SEWER LINES LOCATED OUTSIDE OF PAVED ROADS AND STREETS.
3. CUT AND FILL SLOPES SHALL BE A MAXIMUM OF 1.5 HORIZONTAL TO 1 VERTICAL UNLESS APPROVED BY SBWRD.
4. PLACE 4" MINIMUM TOPSOIL ON ALL CUT AND FILL SLOPES. COMPACT TO 90% OF MODIFIED PROCTOR DENSITY. PROVIDE EROSION CONTROL AND REVEGETATION.
5. MAXIMUM LONGITUDINAL SLOPE OF ROADWAY PLATFORM SHALL BE 15% OR ALTERNATE ACCESS SHALL BE PROVIDED.



**Snyder Basin Water
Reclamation District**

OFF-ROAD PIPE TRENCH AND ACCESS PLATFORM

STANDARD DETAIL

PI-02

Revision Date: 2/23/26