



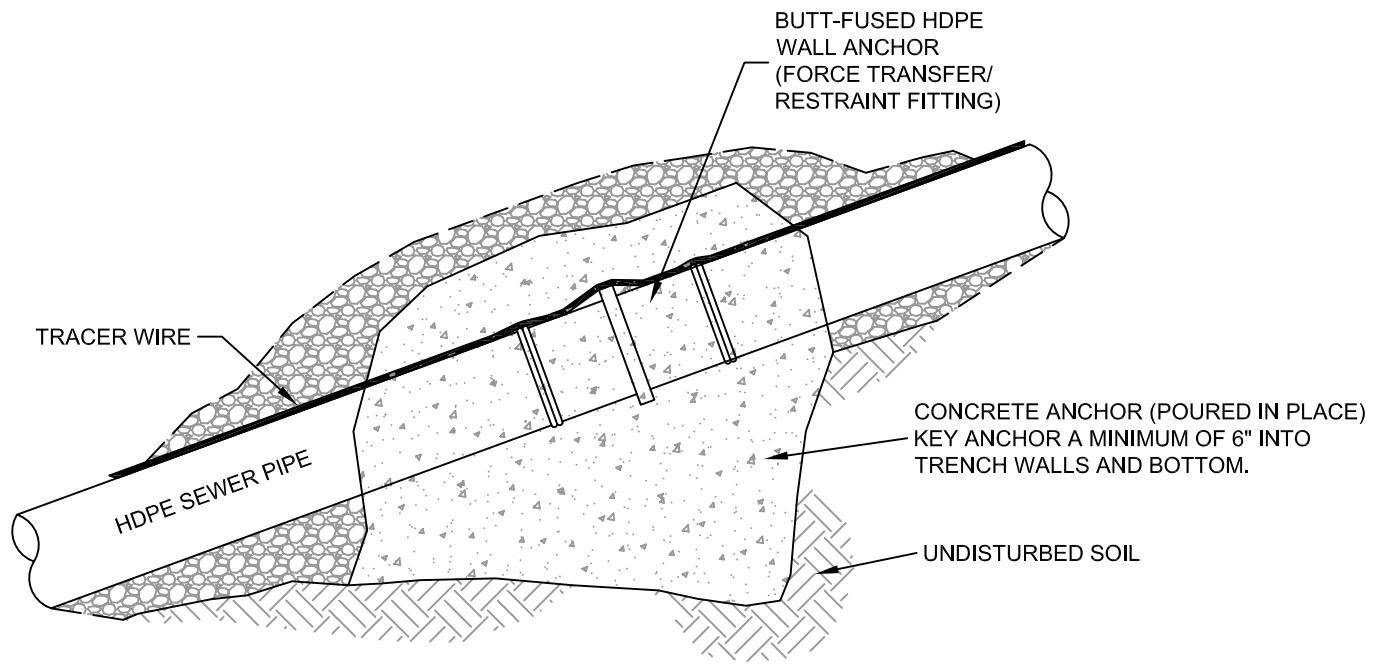

PROFILE

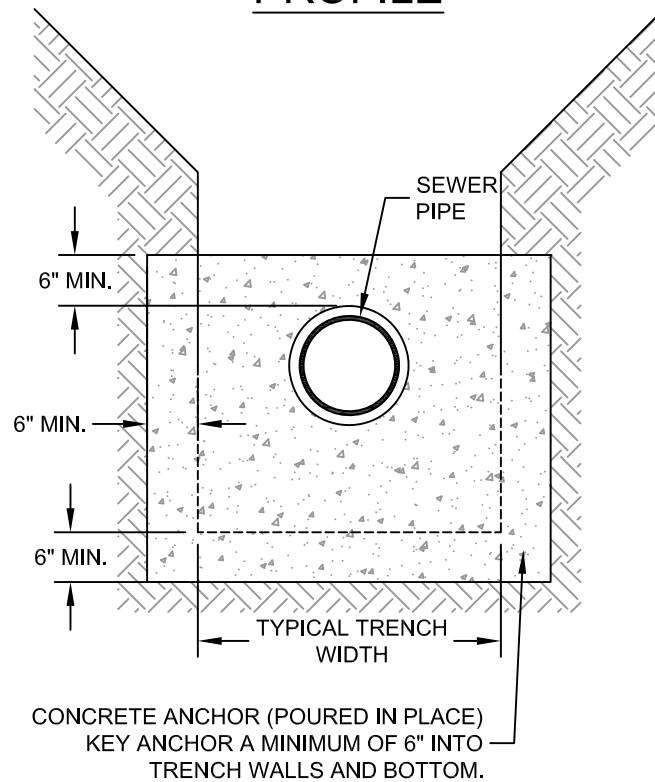

SECTION

NOTES:

1. INSTALL PIPE ANCHORS ON ALL PIPE WITH SLOPES GREATER THAN 33%.
2. PIPE ANCHORS SHALL BE PLACED AT ALTERNATING BUTT-FUSED JOINTS (80' OR 100' SPACING).



**Snyderville Basin Water
Reclamation District**

**PIPE ANCHOR
(HDPE MAIN LINE)**

STANDARD DETAIL

PI-05

Revision Date: 2/23/26