



# Snyderville Basin Water Reclamation District

SNYDERVILLE BASIN WATER RECLAMATION DISTRICT  
PARK CITY, UTAH


EAST CANYON WRF 2026 PREPURCHASE  
DESIGN AND CONSTRUCTION MANAGEMENT SERVICES

PROJECT NO. 204825

ADDENDUM NO. 2  
TO THE  
CONTRACT DOCUMENTS

MAY 8, 2026

Digitally signed by Erin R. Andersen  
Contact Info: Carollo Engineers, Inc.  
Date: 2026.05.08 15:39:06'00'

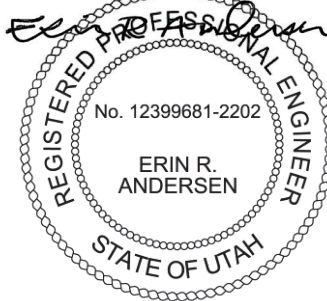

Bidders on the above-named project are hereby notified that the Bidding Documents are modified as indicated below. Bidders are required to acknowledge receipt of this Addendum in the space provided on Document 00410 - Bid Form.

This Addendum shall become part of the Contract and provisions of the Contract apply.

## **SPECIFICATIONS**

The following sections are modified as indicated below.

1. SECTION 00111 - INVITATION TO BID:
  - a. REPLACE section in its entirety with the attached section.
2. SECTION 15241 - HIGH DENSITY POLYETHYLENE (HDPE) PIPE: AWWA C906:
  - a. Revise paragraph 2.03 subparagraph A.2.b. as follows:
    - 1) "Pipe diameter: DIPS dimensions as specified in the Pipe Schedule and as indicated in the on the Drawings."

## **DRAWINGS**

The following drawings are modified as indicated below.

1. DRAWING 00G05:
  - a. REPLACE drawing in its entirety with the attached drawing.
2. DRAWING 10M02:
  - a. Add the following General Note.
    - 1) "Provide long-radius bends at all 90-degree changes of direction in new grit piping."
  - b. Revise Keynote 2.
    - 1) "Reuse existing wall penetration and core drill new penetration through existing masonry wall for new grit piping. Install a grooved end by grooved end, glass lined, ductile iron spool through both penetrations to connect to HDPE piping on either side."
3. DRAWING 04E01:
  - a. REPLACE drawing in its entirety with the attached drawing.

**DOCUMENT 00111**

**INVITATION TO BID  
SNYDERVILLE BASIN WATER RECLAMATION DISTRICT  
PARK CITY, UTAH  
EAST CANYON WATER RECLAMATION FACILITY - 2026 PREPURCHASE PROJECT**

**GENERAL NOTICE**

Snyderville Basin Water Reclamation District (Owner) is requesting Bids for the construction of the following Project:

East Canyon Water Reclamation Facility - 2026 Prepurchase Project  
204825

Bids for the construction of the Project will be received at the Snyderville Basin Water Reclamation District Administration Building located at 2800 Homestead Road, Park City, Utah 84098, until Wednesday, May 20, 2026, at 2:00 p.m. local time. At that time the Bids received will be publicly opened and read.

The Project is located at the East Canyon Water Reclamation Facility at 2909 West Sackett Drive, Park City, Utah and includes the following Work:

Installation and commissioning of new utility water pumps, polymer blending and feed equipment, and electric actuators on the bioreactor weir gates, pre-purchased by the Owner. Additional work includes procurement and installation of new variable frequency drives for the new pumps and replacement of the existing ductile iron grit piping with new HDPE piping.

At the mutual agreement of the Owner and Contractor, the scope of this Contract may be extended to include additional future work identified during or following completion of the original scope. Any such extension shall be at the Owner's discretion and subject to the Contractor's agreement. The terms and conditions established under this Contract shall serve as the basis for any extended scope, with specific scope and compensation to be negotiated and documented by written amendment at the time such work is identified.

**BIDDING DOCUMENTS**

All questions regarding bid documents and terms shall be e-mailed to the Engineer:

Erin Andersen, P.E. at [eandersen@carollo.com](mailto:eandersen@carollo.com)

A full set of Bidding Documents is available for examination at the Engineer's office located at:

Carollo Engineers  
7090 Union Park Avenue, Suite 600  
Salt Lake City, Utah 84047

## **PRE-BID CONFERENCE**

A pre-bid conference for the Project will be held on Wednesday, April 29, 2026 at 2:00 p.m. at the Snyderville Basin Water Reclamation District Administration Building, 2800 Homestead Road, Park City, Utah, 84098. Attendance at the pre-bid conference is encouraged but not required.

## **PREQUALIFICATION OF BIDDERS**

Bids will be accepted only from Bidders prequalified by the Owner. Due to the specialized nature of the construction, the experience and qualifications of Bidders has been evaluated by the Owner. Only Bids submitted by Bidders previously determined by the Owner to be qualified will be considered. Bids received from Bidders who are not prequalified will be returned.

## **OWNER'S RIGHTS**

Owner reserves the right after opening Bids to reject any or all Bids, to waive any informality (non-responsiveness) in a Bid, or to make award to the lowest responsive, responsible Bidder and reject all other Bids, as it may best serve the interest of the Owner.

## **LAWS AND REGULATIONS**

Pursuant to Section 63G-6-103, Utah Procurement Code, "Invitation for bids" shall mean all documents, whether attached or incorporated by reference, utilized for soliciting bids.

Snyderville Basin Water Reclamation District

END OF DOCUMENT

## PIPE SCHEDULE

FLOW STREAM IDENTIFIER	SERVICE	PIPE SIZE (1)	MATERIAL	PRESSURE CLASS/WALL THICKNESS	PIPE SPEC. SECTION	JOINTS/FITTINGS	LINING	COATING	TESTING		NOTES
									METHOD	PRESSURE (psi)	
POL	POLYMER										
	EXPOSED	ALL SIZES	PVC	SCH 80	15230	SW			HH	50	
UW	UTILITY WATER										
	EXPOSED	LESS THAN 2"	PVC	SCH 80	15249	SW/FL			HH	150	
	EXPOSED	2" AND GREATER	DIP	DIPRA 350	15211	FL	CM	FA	HH	150	SEE SECTION 09960
G	GRIT SLURRY										
	EXPOSED	ALL SIZES	HDPE	SDR17	15241	BW/FL			HH	25	

NOTES:

(1) NOMINAL DIAMETER (INCHES)

**PIPE MATERIAL AND JOINT/FITTING ABBREVIATIONS:**

BW BUTT WELD  
 B&SP BELL AND SPIGOT  
 BSP BLACK STEEL PIPE  
 BF BARBED FITTING  
 CF COMPRESSION FITTING  
 CI CAST IRON  
 CISP CAST IRON SOIL PIPE  
 CL CLASS, FOLLOWED BY DESIGNATION  
 CM CEMENT MORTAR  
 CTP COAL TAR PITCH  
 DIP DUCTILE IRON PIPE  
 DWV DRAIN, WASTE AND VENT  
 FL FLANGE  
 FRP FIBERGLASS PIPE  
 GA GAUGE, PRECEDED BY THE DESIGNATION  
 GE GROOVED END PIPE  
 GSP GALVANIZED STEEL PIPE  
 MJ MECHANICAL JOINT  
 MDPE MEDIUM PRESSURE POLYETHENE  
 NPS NOMINAL PIPE SIZE, FOLLOWED BY THE NUMBER IN INCHES  
 PE POLYETHYLENE  
 PTC PUSH-TO-CONNECT  
 PVC POLYVINYL CHLORIDE  
 R-B&SP RESTRAINED BELL AND SPIGOT  
 RMJ RESTRAINED MECHANICAL JOINT  
 RPVC REINFORCED POLYVINYL CHLORIDE TUBING  
 SCH SCHEDULE, FOLLOWED BY THE DESIGNATION  
 SCR D SCREWED-ON/THREADED  
 SST STAINLESS STEEL  
 SW SOLVENT WELD  
 WLD WELD

**LINING AND COATING ABBREVIATIONS:**

ACR ACRYLIC COATING  
 CM CEMENT MORTAR  
 CP CARRIER PIPE  
 EPP EPOXY POLYURETHANE COATING  
 FA FIELD APPLIED COATING  
 GC GEL COAT  
 GL GLASS LINED  
 HSE HIGH SOLIDS EPOXY  
 I INSULATED (ONLY)  
 P PAINTED  
 POL POLYETHYLENE LINED  
 PE POLYETHYLENE-WRAPPED  
 PEE POLYETHYLENE ENCASEMENT  
 PVC POLYVINYL CHLORIDE  
 CE CERAMIC EPOXY  
 CT COAL TAR ENAMEL  
 CTX COAL TAR EPOXY  
 TW TAPE WRAPPED  
 FP FLUOROPOLYMER  
 R RUBBER LINING  
 EPX EPOXY LINED

**TEST PRESSURE METHOD:**

AM AIR METHOD  
 GR GRAVITY METHOD  
 HH HIGH HEAD METHOD  
 LH LOW HEAD METHOD  
 SC SPECIAL CASE  
 PSI POUNDS PER SQUARE INCH

LAST SAVED BY: sfields

DESIGNED ERA	
DRAWN SF	
CHECKED CTA	
DATE APRIL 2026	
ADDENDUM 2	
REV	DATE
BY	DESCRIPTION

PROJECT NO. 204825-100000	FILE NAME: 204825_00G02.dwg
---------------------------	-----------------------------



SNYDERVILLE BASIN WATER RECLAMATION DISTRICT  
 ECWRF 2026 PRE-PURCHASE PROJECT  
 GENERAL  
**PIPE SCHEDULE**

VERIFY SCALES  
 BAR IS ONE INCH ON ORIGINAL DRAWING  
 0 1"  
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

JOB NO. 204825  
 DRAWING NO. 00G05  
 SHEET NO. OF

- # KEY NOTES:
1. PROVIDE NEW 30 AMP SINGLE-POLE CIRCUIT BREAKERS FOR NEW POLYMER UNIT 3 & 4 POWER.
  2. MARK EXISTING POLYMER 1 & 2 CIRCUIT AS SPARE UPON COMPLETION OF DEMOLITION WORK FOR ASSOCIATED EQUIPMENT.
  3. UTILIZE EXISTING CIRCUIT BREAKERS FOR NEW A/C UNIT POWER.

(EXISTING) PANEL LP-S										4/19/2026
LOCATION: SOLIDS HANDLING BLDG ELECTRICAL ROOM		NEMA: 1		PH A WEIGHTED VA		0				
VOLTS: 208/120		FEED: BOTTOM		PH B WEIGHTED VA		0				
PHASE & WIRE: 3 PH 4W		MTG: SURFACE		PH C WEIGHTED VA		0				
INTERRUPT: 65 KAIC		BUS RATING: 150		EQUIP SIZING VA		0				
		MAIN: CB		PANEL AMPS		0.0				
		MAIN RATING: 125 AF 100 AT								
I/C/S DESCRIPTION	LOAD (VA)	BKR	CIR	Ø	CIR	BKR	LOAD (VA)	DESCRIPTION	I/C/S	
PUMP RM LIGHTS		30A-1P	1	A	2	30A-1P		VCP-SP-5 POLYMER BLENDING UNIT	C	
PUMP RM LIGHTS		30A-1P	3	B	4	20A-1P		SPARE		
HOPPER LIGHTS		20A-1P	5	C	6	20A-1P		HOPPER LIGHT		
HOPPER LIGHTS		20A-1P	7	A	8	30A-1P		VCP-SP-6 POLYMER BLENDING UNIT	C	
ROTARY PRESS LIGHTS		20A-1P	9	B	10	20A-1P		SPARE		
ROTARY PRESS LIGHTS		20A-1P	11	C	12	20A-1P		UNIT HEATER		
HVAC RM LIGHTS		20A-1P	13	A	14	20A-1P		LCP-SP		
HVAC RM LIGHTS		20A-1P	15	B	16	20A-2P		WATER HEATER		
OUTSIDE BUILDING LIGHTS		20A-1P	17	C	18					
EMERGENCY LIGHTS		20A-1P	19	A	20	30A-2P		CONDENSING UNIT		
LOWER FLOOR RECPT		20A-1P	21	B	22					
LOWER FLOOR RECPT		20A-1P	23	C	24	20A-2P		EXHAUST FAN		
LOWER FLOOR RECPT		20A-1P	25	A	26					
ROTARY PRESS RECPT		20A-1P	27	B	28	20A-1P		HOPPER SOLENOIDS		
UPPER FLOOR RECPT		20A-1P	29	C	30	20A-1P		HORIZ. CONVEY SOLENOIDS		
ROTARY PRESS RECEIPT		20A-1P	31	A	32	20A-1P		INCLINE CONVEY SOLENOIDS		
ELECTRICAL RM LIGHTS		20A-1P	33	B	34	20A-1P		SPARE		
SPARE		20A-1P	35	C	36	20A-1P		MICROVIEW		
ROTARY PRESS AIR DRYER		20A-1P	37	A	38	20A-1P		SPARE		
SPACE			39	B	40			SPACE		
SPACE			41	C	42			SPACE		

(EXISTING) PANEL LPD										4/7/2026
LOCATION: CHEMICAL PHOSPHOROUS BUILDING		NEMA: 1		PH A WEIGHTED VA		7820				
VOLTS: 208/120		FEED: TOP		PH B WEIGHTED VA		6043				
PHASE & WIRE: 3 PH 4W		MTG: SURFACE		PH C WEIGHTED VA		5330				
INTERRUPT: 18 KAIC		BUS RATING: 400		EQUIP SIZING VA		23460				
		MAIN: MLO		PANEL AMPS		65.1				
I/C/S DESCRIPTION	LOAD (VA)	BKR	CIR	Ø	CIR	BKR	LOAD (VA)	DESCRIPTION	I/C/S	
WATER HEATER	1500					20A-1P		BASEMENT OUTLETS		
	1500	30A-3P	3	B	4	20A-1P		#1 ALUM ALARM P.		
	1500		5	C	6	20A-1P		#2 ALUM ALARM P.		
ELEC ROOM LIGHTS	186	20A-1P	7	A	8	20A-1P	70	FIT-352, FIT-938		
PLC		20A-1P	9	B	10	20A-1P	70	FIT-353, FIT-650		
BASEMENT LIGHTS		20A-1P	11	C	12	20A-1P		SAMPLER		
OVERHEAD CRANE #3		20A-1P	13	A	14	20A-1P	1800	UV CONTROL PANEL		
AC UNIT FOR PLC		20A-1P	15	B	16	20A-2P	1664	ELECTRICAL ROOM MINI SPLIT AC UNIT		
COMP. EXHAUST FAN		20A-1P	17	C	18		1664			
SPARE		20A-2P	19	A	20	20A-1P		SPARE		
			21	B	22	20A-1P	40	FIT-930, FIT-931		
ALUM PUMP 1,2,3	1000	20A-1P	23	C	24	20A-1P	40	FIT-615, FIT-621		
ALUM PUMP 4,5,6	1000	20A-1P	25	A	26	20A-1P	100	SAND FILTER 1&2		
MAIN FLOOR OUTLETS		20A-1P	27	B	28	20A-1P	60	LIT-616 S.F. LEVEL TRAIN 1, LIT-615 F.R. LEVEL TRAIN 2		
AIR DRYER		20A-1P	29	C	30	20A-1P	20	LIT-614 F.R. LEVEL TRAIN 1		
BASEMENT NIGHT LIGHTS		20A-1P	31	A	32	30A-2P	1500	HEAT TRACE CONTROLLER		
HVAC CONTROLLER		20A-1P	33	B	34		1500			
PLC AIR CONDITIONER		20A-1P	35	C	36	20A-1P	20	AIT-608 UV TURBIDIMETER #2		
MAIN FLOOR LIGHTS		20A-1P	37	A	38	20A-1P	100	SAND FILTER 3&4		
MAIN FLOOR LIGHTS		20A-1P	39	B	40	20A-1P		ROOM OUTLET		
MEZZ. LIGHTS		20A-1P	41	C	42	20A-1P	20	LIT-617		

LAST SAVED BY: jrsantaguida

REV	DATE	BY	DESCRIPTION
2	05/08/2026	ERA	ADDENDUM #2

DESIGNED JRS	
DRAWN JDB	
CHECKED CAC	
DATE APRIL 2026	



SNYDERVILLE BASIN WATER RECLAMATION DISTRICT  
 ECWRF 2026 PRE-PURCHASE PROJECT  
 ELECTRICAL  
 PANELBOARD SCHEDULE

VERIFY SCALES BAR IS ONE INCH ON ORIGINAL DRAWING 0 1"	JOB NO. 204825
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	DRAWING NO. 04E01
	SHEET NO. OF